


# KEY NOTES:


1. DEMOLISH CC-MCC-A.
2. DEMOLISH THE AUTOMATIC TRANSFER SWITCH IN CC-MCC-B.
3. EMERGENCY POWER BUS.
4. EMERGENCY POWER ENTERS SECTION 4 OF CC-MCC-A AND RUNS TO THE EMERGENCY POWER BUS. THE EMERGENCY POWER BUS IS DOUBLE TAPPED AND PROVIDES EMERGENCY POWER TO BOTH AUTOMATIC TRANSFER SWITCHES.
5. THE CONDUITS TO UTILITY WATER PUMPS UWP-3313 AND UWP-3311 ARE IN SECTION 2 OF CC-MCC-A.
6. DEMOLISH THE ATS CONTROL WIRING BETWEEN CC-MCC-B AND PCM-3300. THE CONTROL WIRING RUNS THROUGH CC-MCC-A.

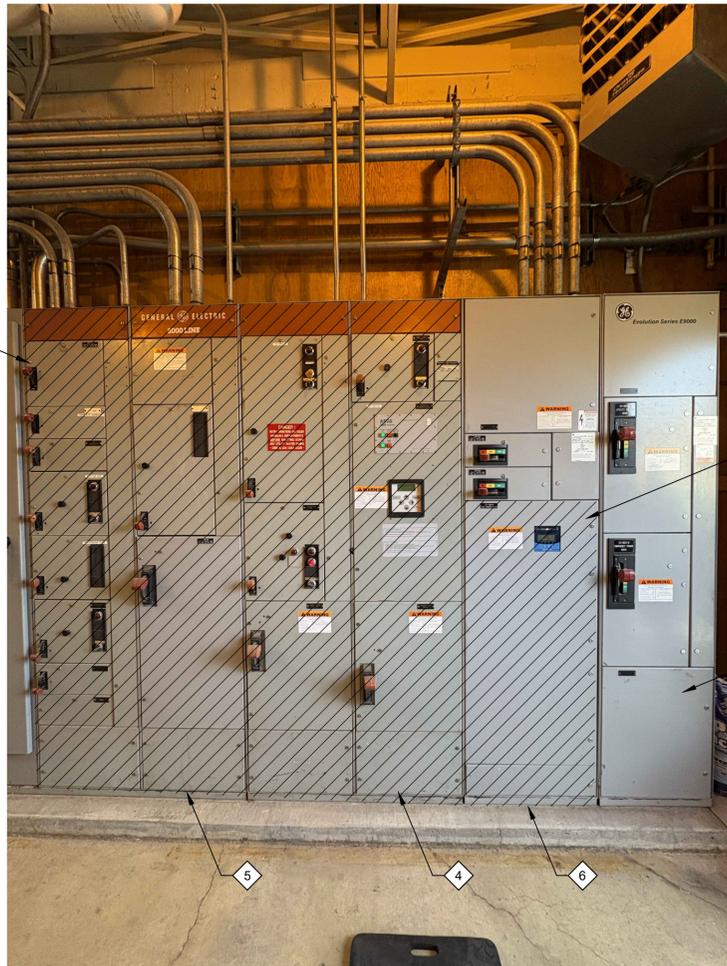

DESCRIPTION  
**1 PHOTO**  
 SCALE: NO SCALE

# KEY NOTES:

1. EMERGENCY POWER BUS.
2. DISCONNECT AND PULL BACK THE INCOMING EMERGENCY POWER CONDUCTORS TO ALLOW FOR THE DEMOLITION OF CC-MCC-A.
3. IDENTIFY AND DEMOLISH THE CONDUCTORS (2 PER PHASE) FROM THE EMERGENCY POWER BUS TO THE ATS IN CC-MCC-A. THE CONDUCTORS FOR THE ATS IN CC-MCC-B CAN BE PROTECTED AND REUSED.

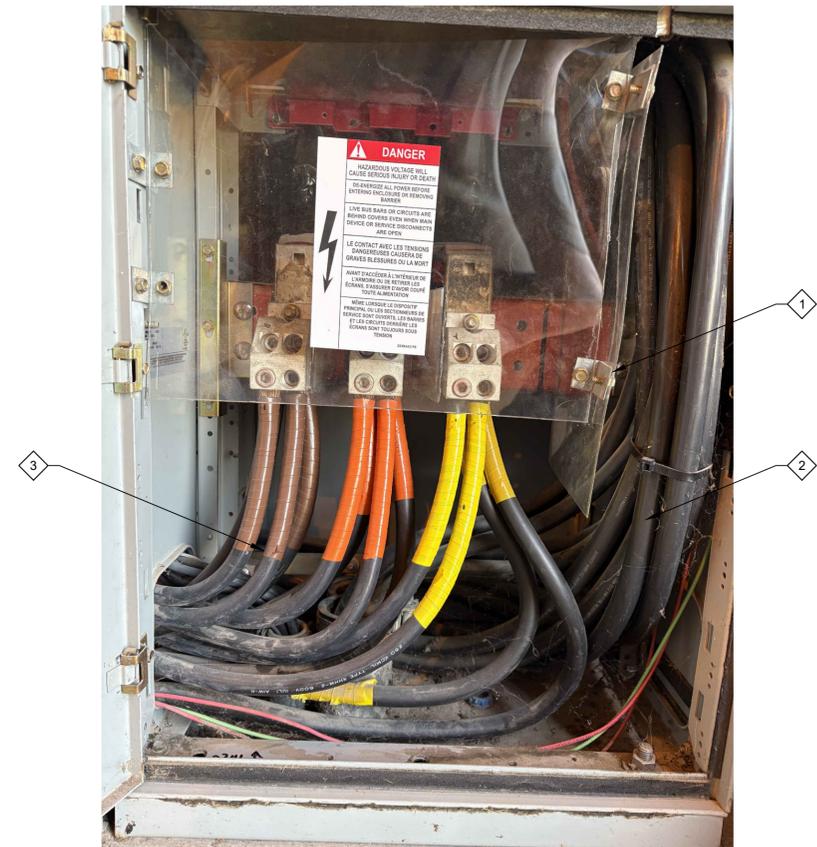


DESCRIPTION  
**2 PHOTO**  
 SCALE: NO SCALE

LAST SAVED BY: evandboom

REV	DATE	BY	DESCRIPTION

DESIGNED CAC
DRAWN CGR
CHECKED
DATE MARCH 2026

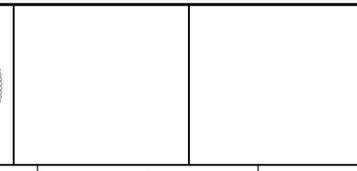


**SOUTH VALLEY WATER RECLAMATION**  
**MCC REPLACEMENT PROJECT**  
 ELECTRICAL  
**UTILITY WATER PUMPING STATION**  
**DEMOLITION DETAILS**

VERIFY SCALES	JOB NO. 202633
BAR IS ONE INCH ON ORIGINAL DRAWING	DRAWING NO. <b>D-6E-02</b>
0 1"	SHEET NO. 66 OF 152
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	





- KEY NOTES:**
1. MAINTAIN EXISTING WIREWAY.
  2. DEMOLISH EXISTING CONTROL CONDUCTORS BETWEEN THE MCCs AND PCM-1400. APPROXIMATELY 70#14.

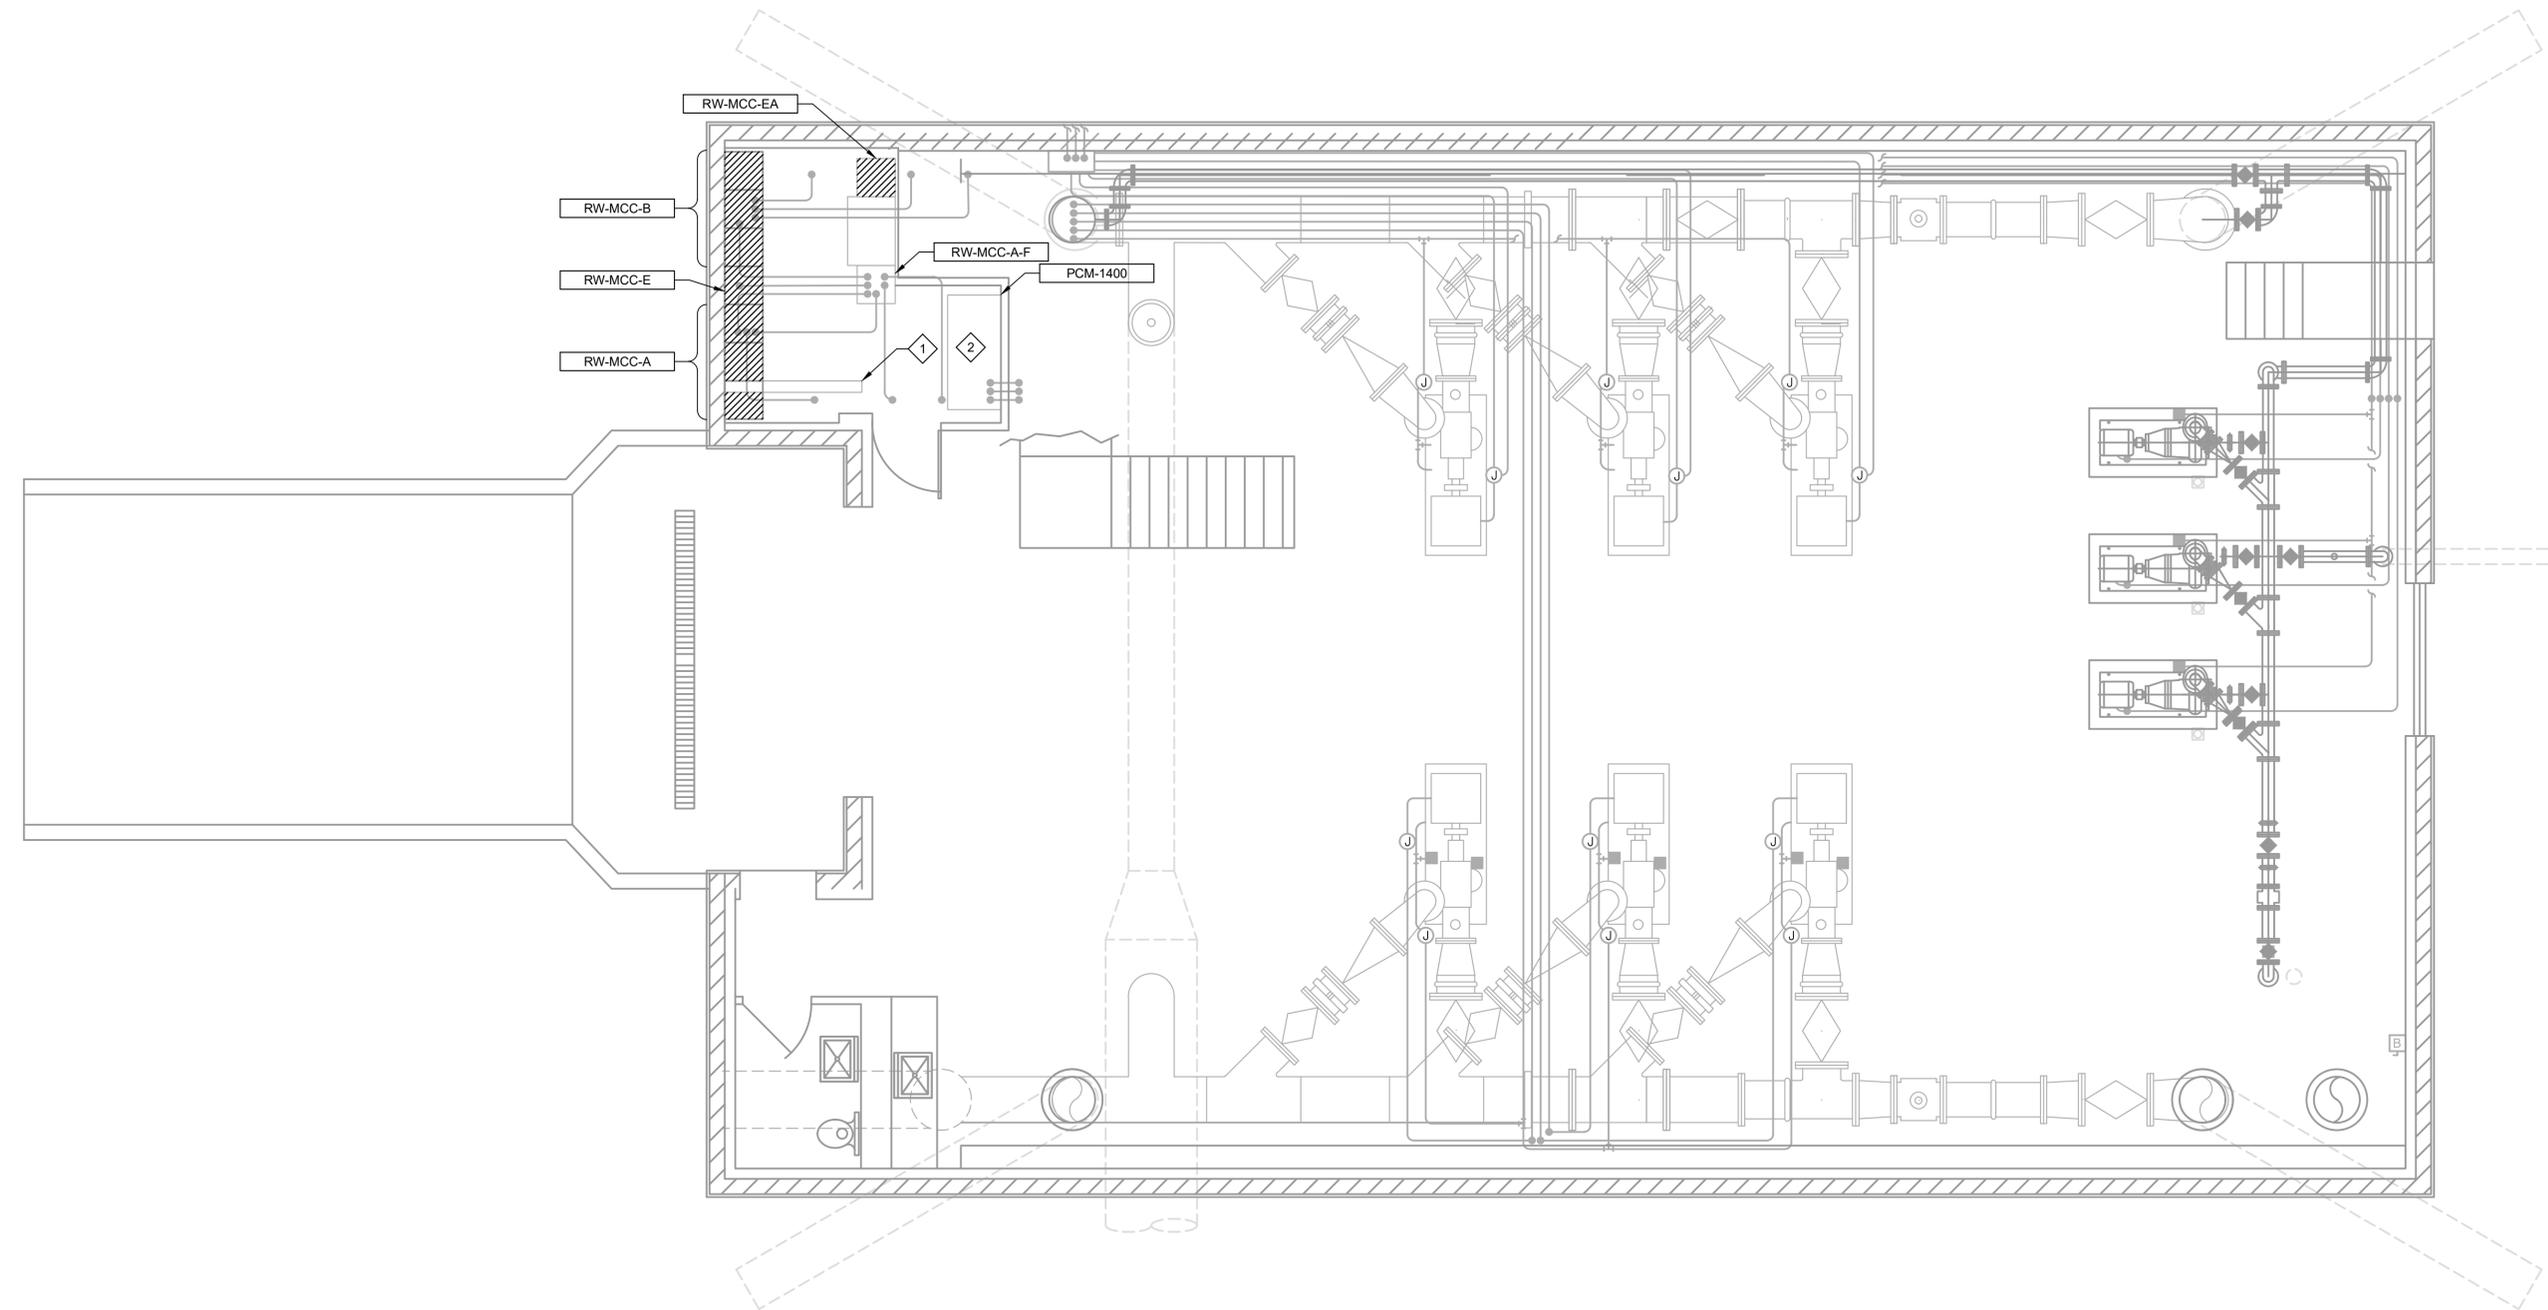

**PLAN**  
 SCALE: 1/4" = 1'-0"  
 FILE: 07-080-100.dwg

LAST SAVED BY: Chierera


REV	DATE	BY	DESCRIPTION

DESIGNED  
CAC

DRAWN  
TLM

CHECKED  
JGB

DATE  
MARCH 2026



**SV South Valley**  
 WATER RECLAMATION FACILITY

7495 South 1300 West  
 West Jordan, Utah 84084

SOUTH VALLEY WATER RECLAMATION  
 MCC REPLACEMENT PROJECT  
 ELECTRICAL  
 RAS/WAS BUILDING #1 LOWER LEVEL  
 DEMOLITION PLAN

VERIFY SCALES  
 BAR IS ONE INCH ON ORIGINAL DRAWING  
 0 1"  
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


JOB NO.  
202633

DRAWING NO.  
**D-14E-01**

SHEET NO.  
68 OF 152



- GENERAL NOTES:**
- SEE DRAWING D-17E-02 FOR ADDITIONAL INFORMATION ON FIRST FLOOR.
- KEY NOTES:**
- DEMOLISH EXISTING CONTROL CONDUCTORS BETWEEN THE MCC'S AND PCM-1500 APPROXIMATELY 8#14.

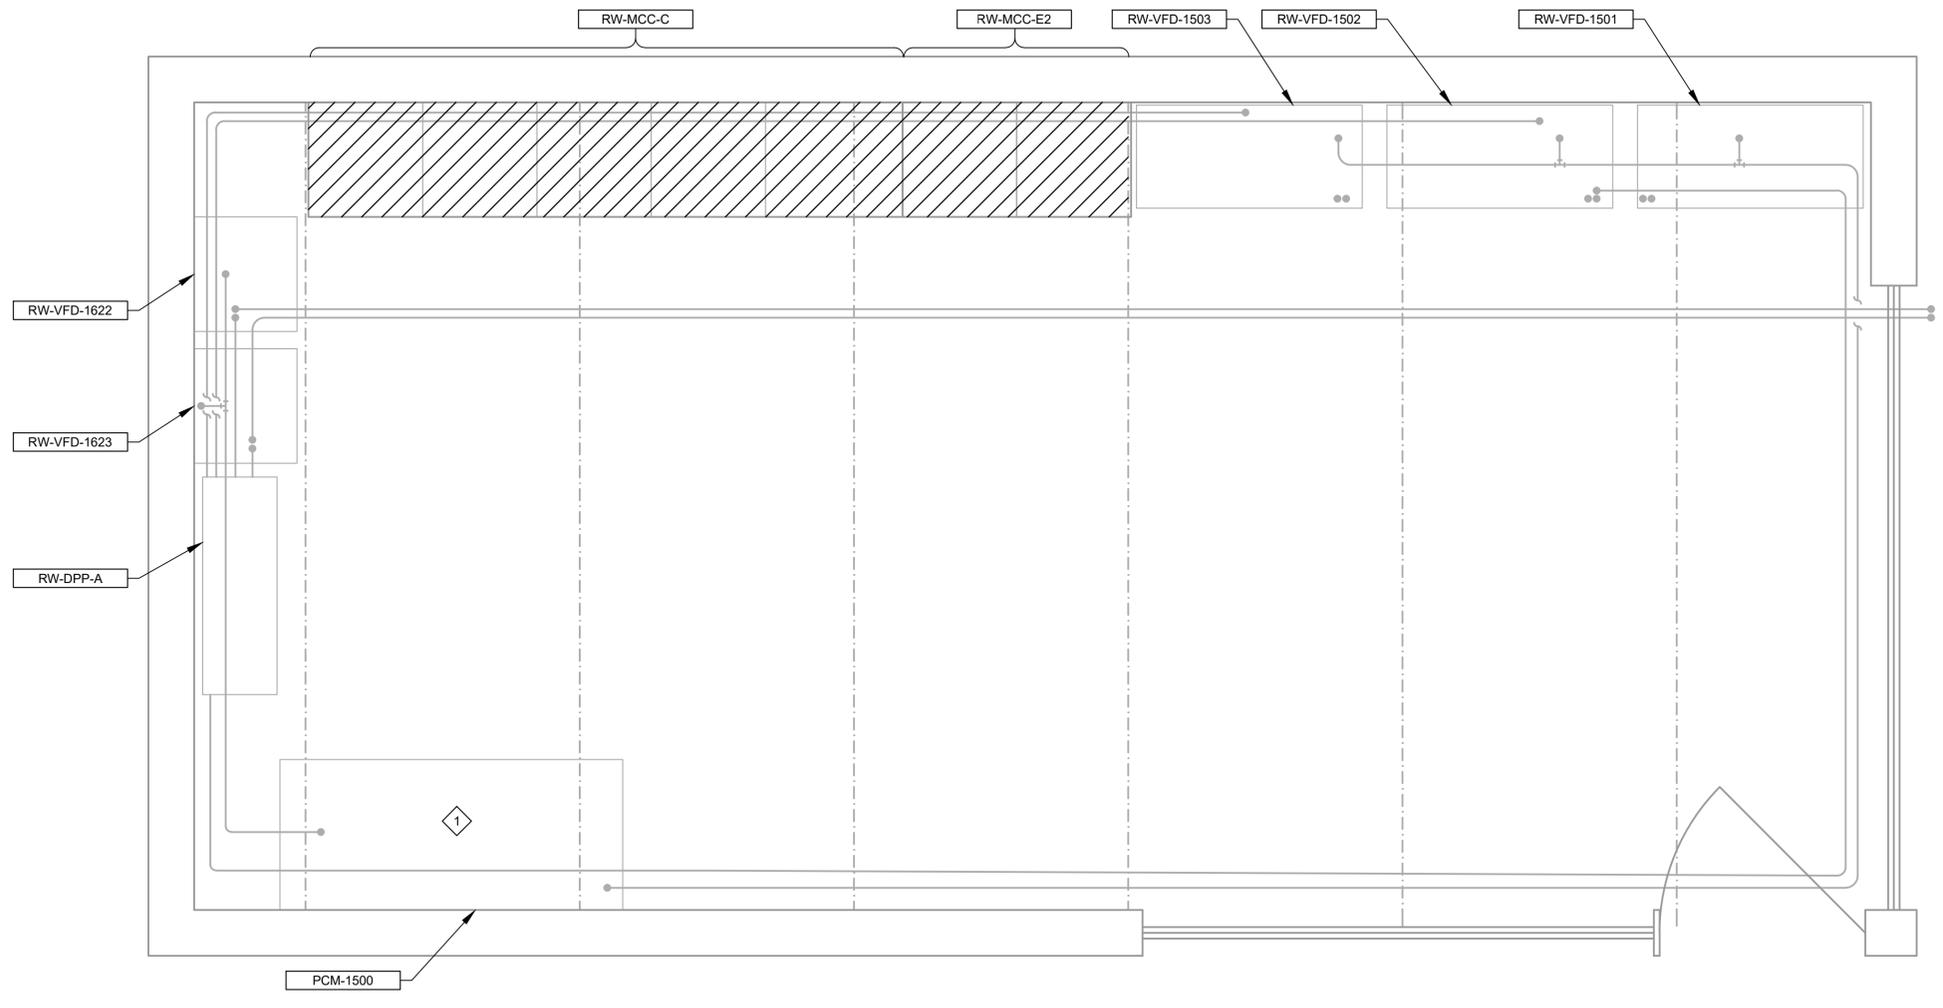

**PLAN**  
SCALE: 3/4" = 1'-0"  
FILE: 07-080-201

LAST SAVED BY: Chertrea

REV	DATE	BY	DESCRIPTION

DESIGNED  
CAC  
DRAWN  
TLM  
CHECKED  
JGB  
DATE  
MARCH 2026



**SV South Valley**  
WATER RECLAMATION FACILITY  
7495 South 1300 West  
West Jordan, Utah 84084

**SOUTH VALLEY WATER RECLAMATION**  
**MCC REPLACEMENT PROJECT**  
ELECTRICAL  
**RAS/WAS BUILDING #2 UPPER LEVEL**  
**DEMOLITION PLAN**

VERIFY SCALES  
BAR IS ONE INCH ON ORIGINAL DRAWING  
0 1"  
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

JOB NO.  
202633  
DRAWING NO.  
**D-17E-01**  
SHEET NO.  
69 OF 152